


Table of Contents

Specialization card 1MG8F rel.03	3
Informations	3
1. Description	5
1.1 Equipment	5
2. Connectors	6
2.1 Digital inputs	6
2.1.1 32 standard digital inputs + 4 rapid inputs	6
2.1.2 8 bidirectional counter inputs 200KHz	8
2.2 Analog inputs	10
2.2.1 4 potentiometric, voltmetric and amperometric analog inputs 12bit	10
2.3 Digital outputs	12
2.3.1 32 protected digital outputs	12
2.3.2 5 STEP-DIRECTION outputs	16
2.4 Analog outputs	18
2.4.1 8 analog outputs +/-10V, 16bit	18
3. Connection examples	19
3.1 Digital inputs	19
3.2 Line Driver counter inputs	20
3.3 PNP / Push Pull counter inputs	21
3.4 Voltmetric and amperometric analog inputs	22
3.5 Voltmetric and potentiometric analog inputs	23
3.6 Protected digital outputs	24
3.7 STEP - DIRECTION outputs 12V	25
3.8 STEP - DIRECTION outputs 24V	26
3.9 Analog outputs	27
4. Electrical features	27
4.0.1 Standard digital inputs	27
4.0.2 Rapid digital inputs	28
4.0.3 Bidirectional counter inputs 200KHz	28
4.0.4 Potentiometric analog inputs	29
4.0.5 Voltmetric analog inputs	29
4.0.6 Amperometric analog inputs	30
4.0.7 Protected digital outputs	30
4.0.8 Stepper outputs	31
4.0.9 Analog outputs	31

Specialization card 1MG8F rel.03

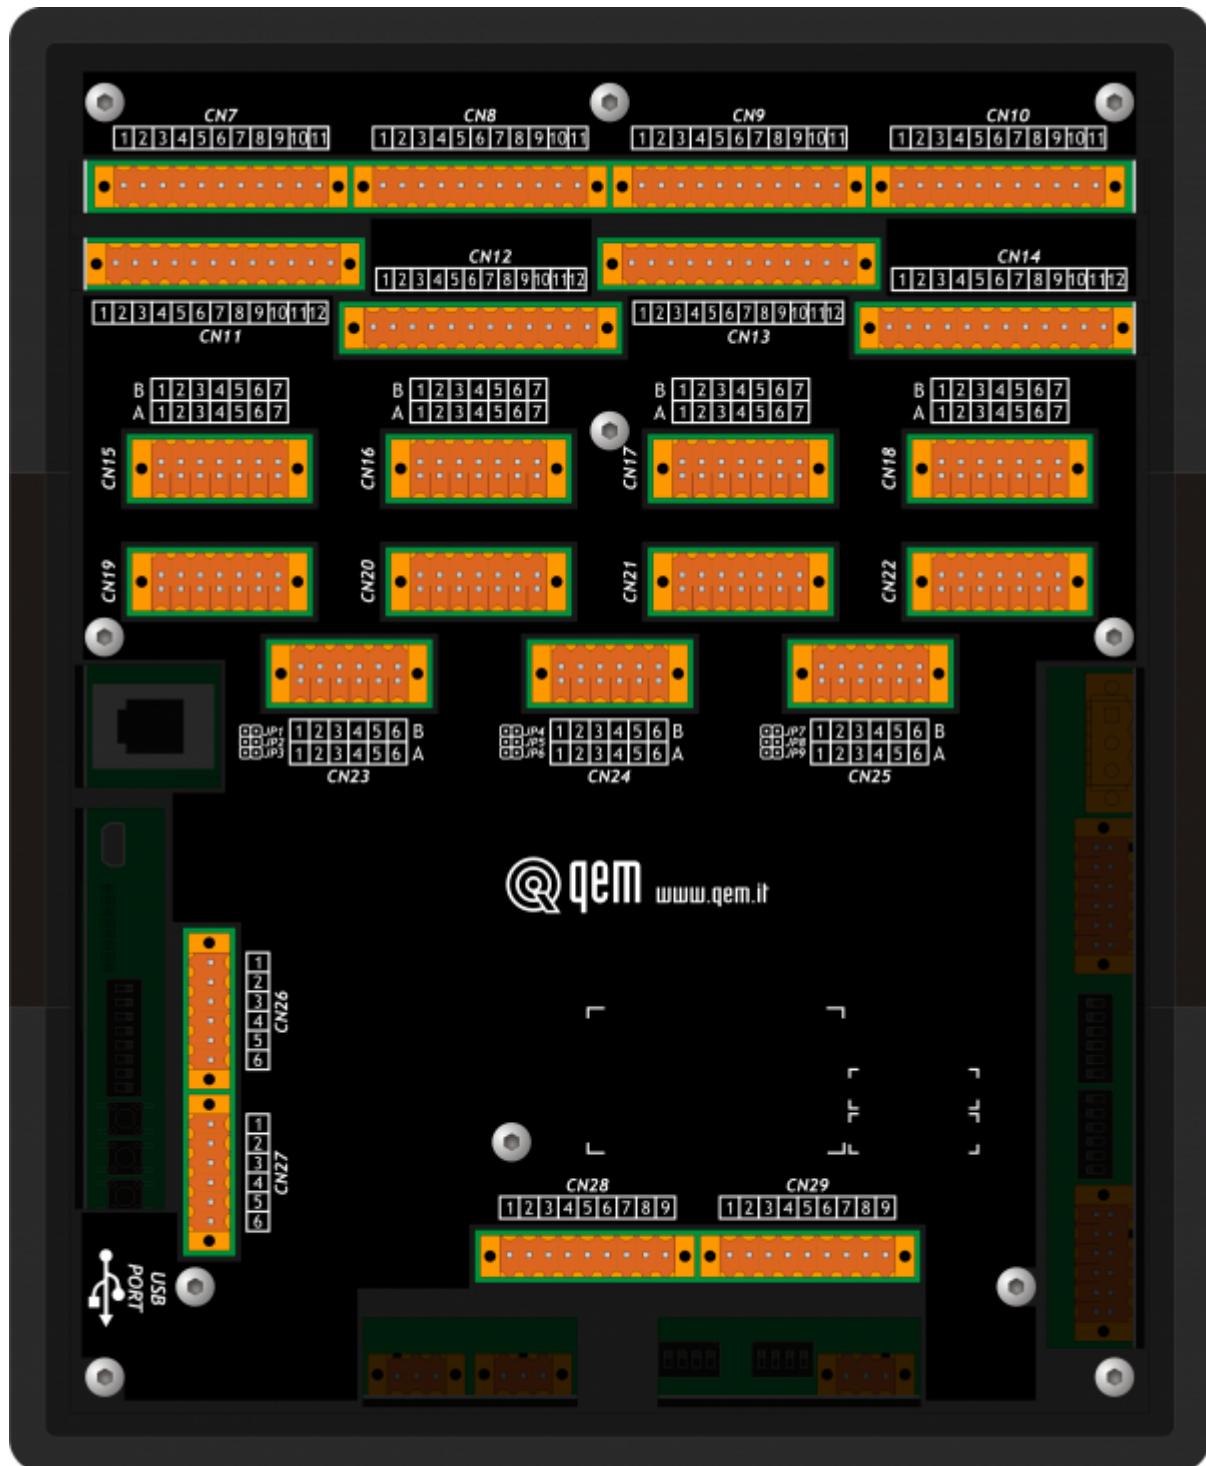

Informations



Quality in Electronic
Manufacturing

Document:	MIM1MG8F03		
Description:	Installation and maintenance manual		
Editor:	Riccardo Furlato		
Approver	Giuliano Tognon		
Link:	http://www.qem.eu/doku/doku.php/en/strumenti/qmoveplus/mim1mg8f03		
Language:	English		
Document release	Hardware release	Description	Note Date

0

03

The step-direction voltare now is settable

11/02/2016

1. Description

The **1MG8F** card of the Qmove+ series.

1.1 Equipment

	32 standard digital inputs (+16 alternative inputs to 8 counters)
	4 analog inputs
	4 rapid inputs
	8 bidirectional counters
	32 digital outputs
	8 analog outputs
	5 step-direction outputs

2. Connectors

2.1 Digital inputs

2.1.1 32 standard digital inputs + 4 rapid inputs

		The electrical features are given in paragraph Electrical Features . The wiring examples are given in paragraph Connection examples				
CN11		Terminal	Symbol	Description		Address
	1	I01(PNP)	PNP type fast input I01	External terminal configuration ¹⁾	FREQ1 ²⁾	
	2	I01(NPN)	PNP type fast input I01			
	3	0V	Common for digital inputs			
	4	I1	Input I1		3.INP01	
	5	I2	Input I2		3.INP02	
	6	I3	Input I3		3.INP03	
	7	I4	Input I4		3.INP04	
	8	I5	Input I5		3.INP05	
	9	I6	Input I6		3.INP06	
	10	I7	Input I7		3.INP07	
	11	I8	Input I8		3.INP08	
	12	0V	Common for digital inputs			

¹⁾ PNP type fast input configuration:

Terminal 1: connect to 12-24Vdc of the power unit

Terminal 2: input

PNP type fast input configuration:

Terminal 1: input

Terminal 2: connect to 0V (terminal 3)

²⁾ can be used as frequency input for a FREQ device, indicating 1 in the device declaration

CN12		Terminal	Symbol	Description		Address
	1	I02(PNP)	PNP type fast input I02	External terminal configuration ¹⁾	FREQ2 ²⁾	
	2	I02(NPN)	NPN type fast input I02			
	3	0V	Common for digital inputs			
	4	I9	Input I9		3.INP09	
	5	I10	Input I10		3.INP10	
	6	I11	Input I11		3.INP11	
	7	I12	Input I12		3.INP12	
	8	I13	Input I13		3.INP13	
	9	I14	Input I14		3.INP14	
	10	I15	Input I15		3.INP15	
	11	I16	Input I16		3.INP16	
	12	0V	Common for digital inputs			

¹⁾ PNP type fast input configuration:

Terminal 1: connect to 12-24Vdc of the power unit

Terminal 2: input

PNP type fast input configuration:

Terminal 1: input

Terminal 2: connect to 0V (terminal 3)

²⁾ can be used as frequency input for a FREQ device, indicating 2 in the device declaration

CN13	Terminal	Symbol	Description	Address
	1	I03(PNP)	PNP type fast input I03	External terminal configuration ¹⁾
	2	I03(NPN)	NPN type fast input I03	
	3	0V	Common for digital inputs	
	4	I17	Input I17	3.INP17
	5	I18	Input I18	3.INP18
	6	I19	Input I19	3.INP19
	7	I20	Input I20	3.INP20
	8	I21	Input I21	3.INP21
	9	I22	Input I22	3.INP22
	10	I23	Input I23	3.INP23
	11	I24	Input I24	3.INP24
	12	0V	Common for digital inputs	

¹⁾ **NPN type fast input configuration:**

Terminal 1: connect to 12-24Vdc of the power unit

Terminal 2: input

PNP type fast input configuration:

Terminal 1: input

Terminal 2: connect to 0V (terminal 3)

CN14	Terminal	Symbol	Description	Address
	1	I04(PNP)	PNP type fast input I04	External terminal configuration ¹⁾
	2	I04(NPN)	NPN type fast input I04	
	3	0V	Common for digital inputs	
	4	I25	Input I25	3.INP25
	5	I26	Input I26	3.INP26
	6	I27	Input I27	3.INP27
	7	I28	Input I28	3.INP28
	8	I29	Input I29	3.INP29
	9	I30	Input I30	3.INP30
	10	I31	Input I31	3.INP31
	11	I32	Input I32	3.INP32
	12	0V	Common for digital inputs	

¹⁾ **NPN type fast input configuration:**

Terminal 1: connect to 12-24Vdc of the power unit

Terminal 2: input

PNP type fast input configuration:

Terminal 1: input

Terminal 2: connect to 0V (terminal 3)

2.1.2 8 bidirectional counter inputs 200KHz

	The electrical features are given in paragraph Electrical features . The wiring examples are given in paragraph Connection examples						
CN15	Terminal	Symbol	Description	Address			
	1A		Internal bridge 1A -1B ¹⁾				
	2A	PHA1	Phase A	Count 1 PNP Push-Pull ²⁾	3.INP33	3.CNT01	
	3A	PHB1	Phase B		3.INP34		
	4A	Z1	Z				1.INT01
	5A	0V					
	6A	0V		Common for count inputs			
	7A	0V					
	1B		Internal bridge 1A -1B ³⁾				
	2B	PHA1+	+ PHA	Count 1 Line Driver	3.INP33	3.CNT01	
	3B	PHB1+	+ PHB		3.INP34		
	4B	Z1+	+ Z				
	5B	PHA1-	- PHA				
	6B	PHB1-	- PHB				
	7B	Z1-	- Z				
					1.INT01		

^{1), 3)} Used to power the encoder. See [Connection examples](#).

²⁾ PNP/Push-Pull type count input configuration:

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

CN16	Terminal	Symbol	Description	Address	
	1A		Internal bridge 1A -1B ¹⁾		
	2A	PHA2	Phase A	Count 2 PNP Push-Pull ²⁾	3.CNT02
	3A	PHB2	Phase B		
	4A	Z2	Z		
	5A	0V			
	6A	0V		Common for count inputs	
	7A	0V			
	1B		Internal bridge 1A -1B ³⁾		
	2B	PHA2+	+ PHA	Count 2 Line Driver	3.CNT02
	3B	PHB2+	+ PHB		
	4B	Z2+	+ Z		
	5B	PHA2-	- PHA		
	6B	PHB2-	- PHB		
	7B	Z2-	- Z		
					1.INT02

^{1), 3)} Used to power the encoder. See [Connection examples](#).

²⁾ PNP/Push-Pull type count input configuration:

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

CN17	Terminal	Symbol	Description	Address	
	1A		Internal bridge 1A -1B ¹⁾		
	2A	PHA3	Phase A	Count 3 PNP Push-Pull ²⁾	3.CNT03
	3A	PHB3	Phase B		
	4A	Z3	Z		
	5A	0V			
	6A	0V		Common for count inputs	
	7A	0V			
	1B		Internal bridge 1A -1B ³⁾		
	2B	PHA3+	+ PHA	Count 3 Line Driver	3.CNT03
	3B	PHB3+	+ PHB		
	4B	Z3+	+ Z		
	5B	PHA3-	- PHA		
	6B	PHB3-	- PHB		
	7B	Z3-	- Z		
					1.INT03

^{1), 3)} Used to power the encoder. See [Connection examples](#).

²⁾ PNP/Push-Pull type count input configuration:

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

CN18	Terminal	Symbol	Description		Address			
	1A		Internal bridge 1A -1B ¹⁾					
	2A	PHA4	Phase A	Count 4 PNP Push-Pull ²⁾	3.INP39	3.CNT04		
	3A	PHB4	Phase B		3.INP40			
	4A	Z4	Z		1.INT04			
	5A	0V						
	6A	0V		Common for count inputs				
	7A	0V						
	1B		Internal bridge 1A -1B ³⁾					
	2B	PHA4+	+ PHA	Count 4 Line Driver	3.INP39	3.CNT04		
	3B	PHB4+	+ PHB		3.INP40			

^{1), 3)} Used to power the encoder. See [Connection examples](#).²⁾ **PNP/Push-Pull type count input configuration:**

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

CN19	Terminal	Symbol	Description		Address			
	1A		Internal bridge 1A -1B ¹⁾					
	2A	PHA5	Phase A	Count 5 PNP Push-Pull ²⁾	3.INP41	3.CNT05		
	3A	PHB5	Phase B		3.INP42			
	4A	Z5	Z		1.INT05			
	5A	0V						
	6A	0V		Common for count inputs				
	7A	0V						
	1B		Internal bridge 1A -1B ³⁾					
	2B	PHA5+	+ PHA	Count 5 Line Driver	3.INP41	3.CNT05		
	3B	PHB5+	+ PHB		3.INP42			

^{1), 3)} Used to power the encoder. See [Connection examples](#).²⁾ **PNP/Push-Pull type count input configuration:**

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

CN20	Terminal	Symbol	Description		Address			
	1A		Internal bridge 1A -1B ¹⁾					
	2A	PHA6	Phase A	Count 6 PNP Push-Pull ²⁾	3.INP43	3.CNT06		
	3A	PHB6	Phase B		3.INP44			
	4A	Z6	Z		1.INT06			
	5A	0V						
	6A	0V		Common for count inputs				
	7A	0V						
	1B		Internal bridge 1A -1B ³⁾					
	2B	PHA6+	+ PHA	Count 6 Line Driver	3.INP43	3.CNT06		
	3B	PHB6+	+ PHB		3.INP44			

^{1), 3)} Used to power the encoder. See [Connection examples](#).²⁾ **PNP/Push-Pull type count input configuration:**

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

CN21	Terminal	Symbol	Description		Address			
	1A		Internal bridge 1A -1B ¹⁾					
	2A	PHA7	Phase A	Count 7 PNP Push-Pull ²⁾	3.INP45	3.CNT07		
	3A	PHB7	Phase B		3.INP46			
	4A	Z7	Z		1.INT07			
	5A	0V		Common for count inputs				
	6A	0V						
	7A	0V						
	1B		Internal bridge 1A -1B ³⁾					
	2B	PHA7+	+ PHA	Count 7 Line Driver	3.INP45	3.CNT07		
	3B	PHB7+	+ PHB		3.INP46			

^{1), 3)} Used to power the encoder. See [Connection examples](#).

²⁾ PNP/Push-Pull type count input configuration:

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

CN22	Terminal	Symbol	Description		Address			
	1A		Internal bridge 1A -1B ¹⁾					
	2A	PHA8	Phase A	Count 8 PNP Push-Pull ²⁾	3.INP47	3.CNT08		
	3A	PHB8	Phase B		3.INP48			
	4A	Z8	Z		1.INT08			
	5A	0V		Common for count inputs				
	6A	0V						
	7A	0V						
	1B		Internal bridge 1A -1B ³⁾					
	2B	PHA8+	+ PHA	Count 8 Line Driver	3.INP47	3.CNT08		
	3B	PHB8+	+ PHB		3.INP48			

^{1), 3)} Used to power the encoder. See [Connection examples](#).

²⁾ PNP/Push-Pull type count input configuration:

Terminal 5B: connect to terminal 5A

Terminal 6B: connect to terminal 6A

Terminal 7B: connect to terminal 7A

2.2 Analog inputs

2.2.1 4 potentiometric, voltmetric and amperometric analog inputs 12bit

	The electrical features are given in paragraph Electrical features . The wiring examples are given in paragraph Connection examples
--	--

CN28	Terminal	Symbol	Description	Address
	1	GAI	Common for analog inputs	
	2	IA1	analog input 1	3.AI01
	3	SEL1V	Analog input selector 1 voltmetric 0-10V ¹⁾	
	4	SEL1C	Analog input selector 1 amperometric 0-20mA ²⁾	
	5	GAI	Common for analog inputs	
	6	IA2	analog input 2	3.AI02
	7	SEL2V	Analog input selector 2 voltmetric 0-10V ³⁾	
	8	SEL2C	Analog input selector 2 amperometric 0-20mA ⁴⁾	
	9	VREF	Reference voltage	

^{1), 3)} Connecting this terminal to GAI, the input functions as voltmetric 0-10V

^{2), 4)} Connecting this terminal to GAI, the input functions as amperometric 0-20mA

CN29	Terminal	Symbol	Description	Address
	1	GAI	Common for analog inputs	
	2	IA3	analog input 3	3.AI03
	3	SEL3V	Analog input selector 3 voltmetric 0-10V ¹⁾	
	4	SEL3C	Analog input selector 3 amperometric 0-20mA ²⁾	
	5	GAI	Common for analog inputs	
	6	IA4	analog input 4	3.AI04
	7	SEL4V	Analog input selector 4 voltmetric 0-10V ³⁾	
	8	SEL4C	Analog input selector 4 amperometric 0-20mA ⁴⁾	
	9	VREF	Reference voltage	

^{1), 3)} Connecting this terminal to GAI, the input functions as voltmetric 0-10V

^{2), 4)} Connecting this terminal to GAI, the input functions as amperometric 0-20mA

2.3 Digital outputs

2.3.1 32 protected digital outputs

	The electric features are listed on the paragraph Electric features . The example of the connections are listed on the Connection examples			
CN7	Terminal	Symbol	Description	Address
	1	V1+	Input for outputs power supply O1÷O8 (12÷28V dc)	
	2	O1	Digital output 1	3.OUT01
	3	O2	Digital output 2	3.OUT02
	4	V1-	Input for outputs power supply O1÷O8 (0V dc)	
	5	O3	Digital output 3	3.OUT03
	6	O4	Digital output 4	3.OUT04
	7	V1-	Input for outputs power supply O1÷O8 (0V dc)	
	8	O5	Digital output 5	3.OUT05
	9	O6	Digital output 6	3.OUT06
	10	O7	Digital output 7	3.OUT07
	11	O8	Digital output 8	3.OUT08

CN8	Terminal	Symbol	Description	Address
	1	V2+	Input for outputs power supply O9÷O16 (12÷28V dc)	
	2	O9	Digital output 9	3.OUT09
	3	O10	Digital output 10	3.OUT10
	4	V2-	Input for outputs power supply (0V dc)	
	5	O11	Digital output 11	3.OUT11
	6	O12	Digital output 12	3.OUT12
	7	V2-	Input for outputs power supply O9÷O16 (0V dc)	
	8	O13	Digital output 13	3.OUT13
	9	O14	Digital output 14	3.OUT14
	10	O15	Digital output 15	3.OUT15
	11	O16	Digital output 16	3.OUT16

CN9	Terminal	Symbol	Description	Address
	1	V3+	Input for outputs power supply O17÷O24 (12÷28V dc)	
	2	O17	Digital output 17	3.OUT17
	3	O18	Digital output 18	3.OUT18
	4	V3-	Input for outputs power supply O17÷O24 (0V dc)	
	5	O19	Digital output 19	3.OUT19
	6	O20	Digital output 20	3.OUT20
	7	V3-	Input for outputs power supply O17÷O24 (0V dc)	
	8	O21	Digital output 21	3.OUT21
	9	O22	Digital output 22	3.OUT22
	10	O23	Digital output 23	3.OUT23
	11	O24	Digital output 24	3.OUT24

CN10	Terminal	Symbol	Description	Address
	1	V4+	Input for outputs power supply O25÷O32 (12÷28V dc)	
	2	O25	Digital output 25	3.OUT25
	3	O26	Digital output 26	3.OUT26
	4	V4-	Input for outputs power supply O25÷O32 (0V dc)	
	5	O27	Digital output 27	3.OUT27
	6	O28	Digital output 28	3.OUT28
	7	V4-	Input for outputs power supply O25÷O32 (0V dc)	
	8	O29	Digital output 29	3.OUT29
	9	O30	Digital output 30	3.OUT30
	10	O31	Digital output 31	3.OUT31
	11	O32	Digital output 32	3.OUT32

2.3.2 5 STEP-DIRECTION outputs

	The electrical features are given in section Electrical features . The example of the connection are given in section Connection examples			
CN23	Terminal	Symbol	Description	Address
	1A	VD1	Internal bridge 1A -1B	Push-Pull Line Driver
	2A	DIR1+	DIRECTION 1 output	
	3A	STEP1+	STEP 1 output	
	4A	DIR2+	DIRECTION 2 output	
	5A	STEP2+	STEP 2 output	
	6A	0V	Stepper outputs common	
	1B	VD1	Internal bridge 1A -1B	
	2B	DIR1-	DIRECTION 1 complementary output	
	3B	STEP1-	STEP 1 complementary output	
	4B	DIR2-	DIRECTION 2 complementary output	
5B	STEP2-	STEP 2 complementary output		
6B	0V	Stepper outputs common		
CN24	Terminal	Symbol	Description	Address
	1A	VD2	Internal bridge 1A -1B	Push-Pull Line Driver
	2A	DIR3+	DIRECTION 3 output	
	3A	STEP3+	STEP 3 output	
	4A	DIR4+	DIRECTION 4 output	
	5A	STEP4+	STEP 4 output	
	6A	0V	Stepper outputs common	
	1B	VD2	Internal bridge 1A -1B	
	2B	DIR3-	DIRECTION 3 complementary output	
	3B	STEP3-	STEP 3 complementary output	
	4B	DIR4-	DIRECTION 4 complementary output	
5B	STEP4-	STEP 4 complementary output		
6B	0V	Stepper outputs common		
CN25	Terminal	Symbol	Description	Address
	1A	VD3	Internal bridge 1A -1B	Push-Pull Line Driver
	2A	DIR5+	DIRECTION 5 output	
	3A	STEP5+	STEP 5 output	
	4A	-	n.c.	
	5A	-	n.c.	
	6A	0V	Stepper outputs common	
	1B	VD3	Internal bridge 1A -1B	
	2B	DIR5-	DIRECTION 5 complementary output	
	3B	STEP5-	STEP 5 complementary output	
	4B	-	n.c.	
5B	-	n.c.		
6B	0V	Stepper outputs common		

With JP1 to JP9 jumper, you can set the nominal voltage of the STEP and DIR outputs.



For each connector should be inserted only one bridge at a time
If you select one of the two voltages 5V(JP3,JP6,JP9) or 12V(JP1,JP4,JP7) the 1A and 1B terminals must be disconnected

	Name jumper	Setting	Nominal voltage
	JP1	INSERTED	12V (voltage supplied by the device)
	JP2	INSERTED	VD1 (Voltage to be supplied to terminals 1A or 1B)
	JP3	INSERTED	5V (Voltage supplied by the device)

	Name jumper	Setting	Nominal voltage
	JP4	INSERTED	12V (voltage supplied by the device)
	JP5	INSERTED	VD2 (Voltage to be supplied to terminals 1A or 1B)
	JP6	INSERTED	5V (Voltage supplied by the device)
	JP7	INSERTED	12V (voltage supplied by the device)
	JP8	INSERTED	VD3 (Voltage to be supplied to terminals 1A or 1B)
	JP9	INSERTED	5V (Voltage supplied by the device)

STEP/DIR

+12V	JP1,JP4,JP7
VDx	JP2,JP5,JP8
+5V	JP3,JP6,JP9


2.4 Analog outputs

2.4.1 8 analog outputs +/-10V, 16bit


	The electrical features are given in paragraph Electrical features . The wiring examples are given in paragraph Connection examples			
	CN26	Terminal	Symbol	Description
	1	GAO	Common for analog outputs	
	2	AO1	Analog output 1	3.AN01
	3	AO2	Analog output 2	3.AN02
	4	GAO	Common for analog outputs	
	5	AO3	Analog output 3	3.AN03
	CN27	Terminal	Symbol	Description
	1	GAO	Common for analog outputs	
	2	AO5	Analog output 5	3.AN05
	3	AO6	Analog output 6	3.AN06
	4	GAO	Common for analog outputs	
	5	AO7	Analog output 7	3.AN07
	6	AO8	Analog output 8	3.AN08

3. Connection examples


3.1 Digital inputs

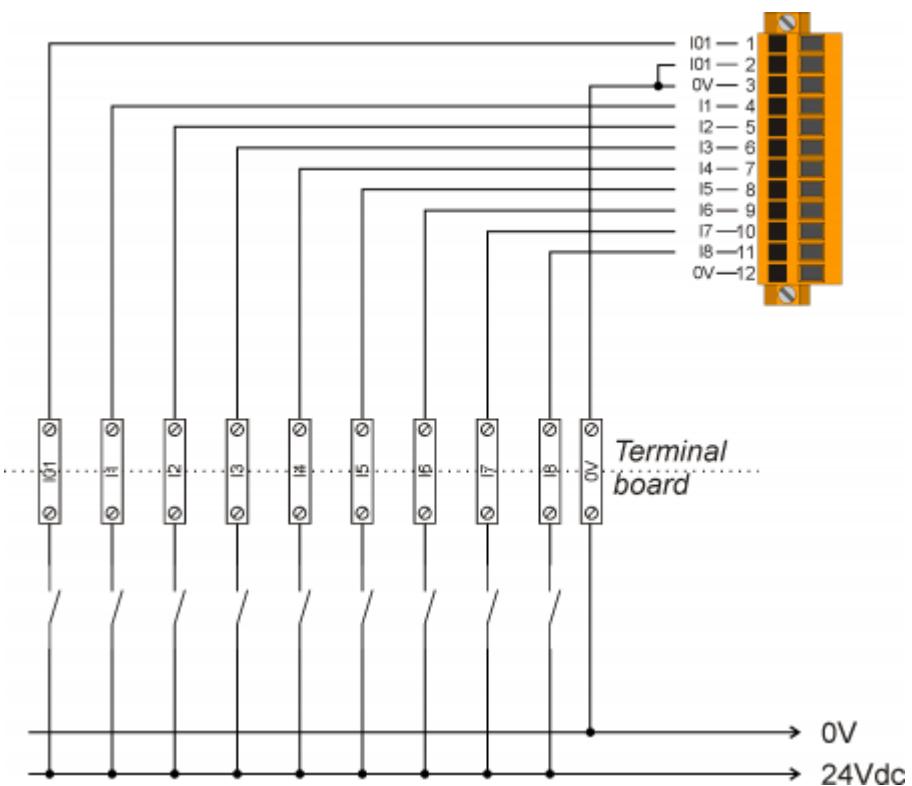


3.2 Line Driver counter inputs

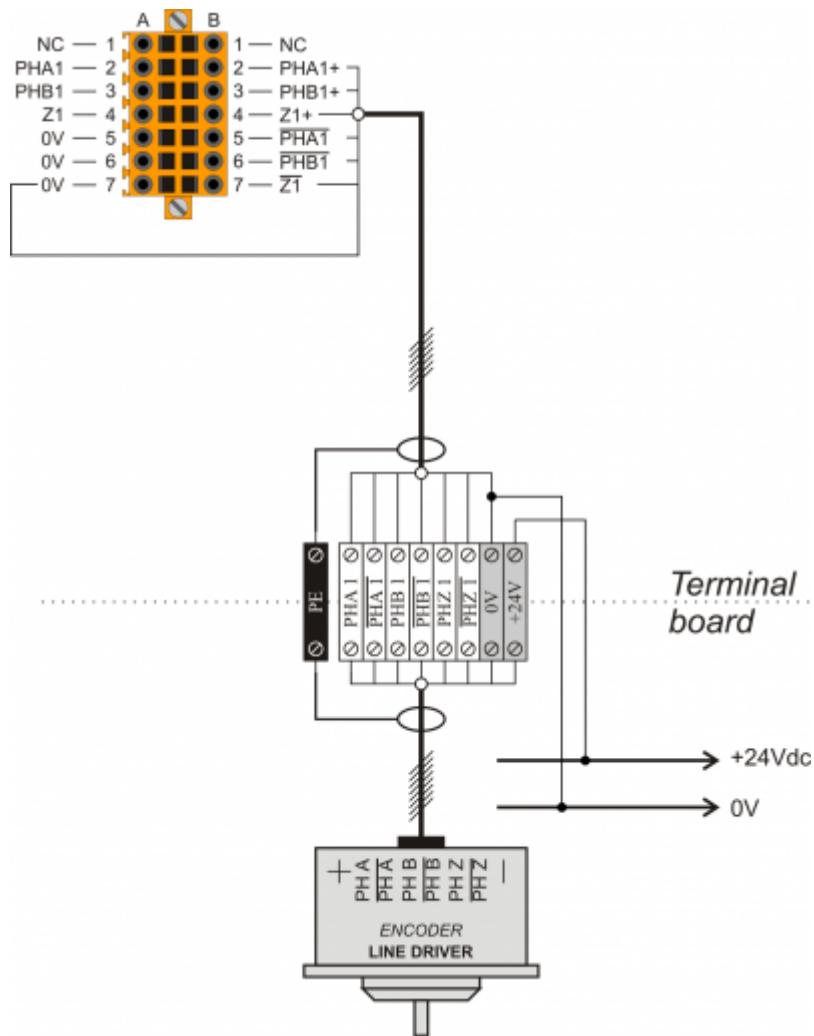


3.3 PNP / Push Pull counter inputs

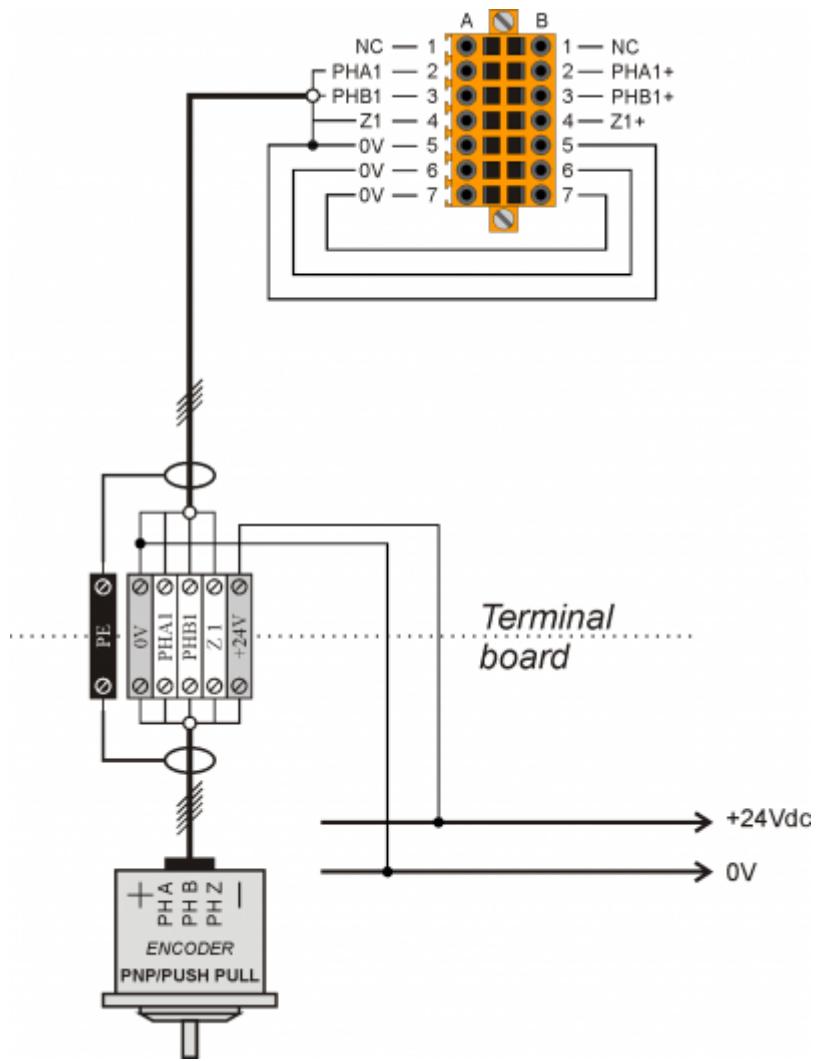


3.4 Voltmetric and amperometric analog inputs

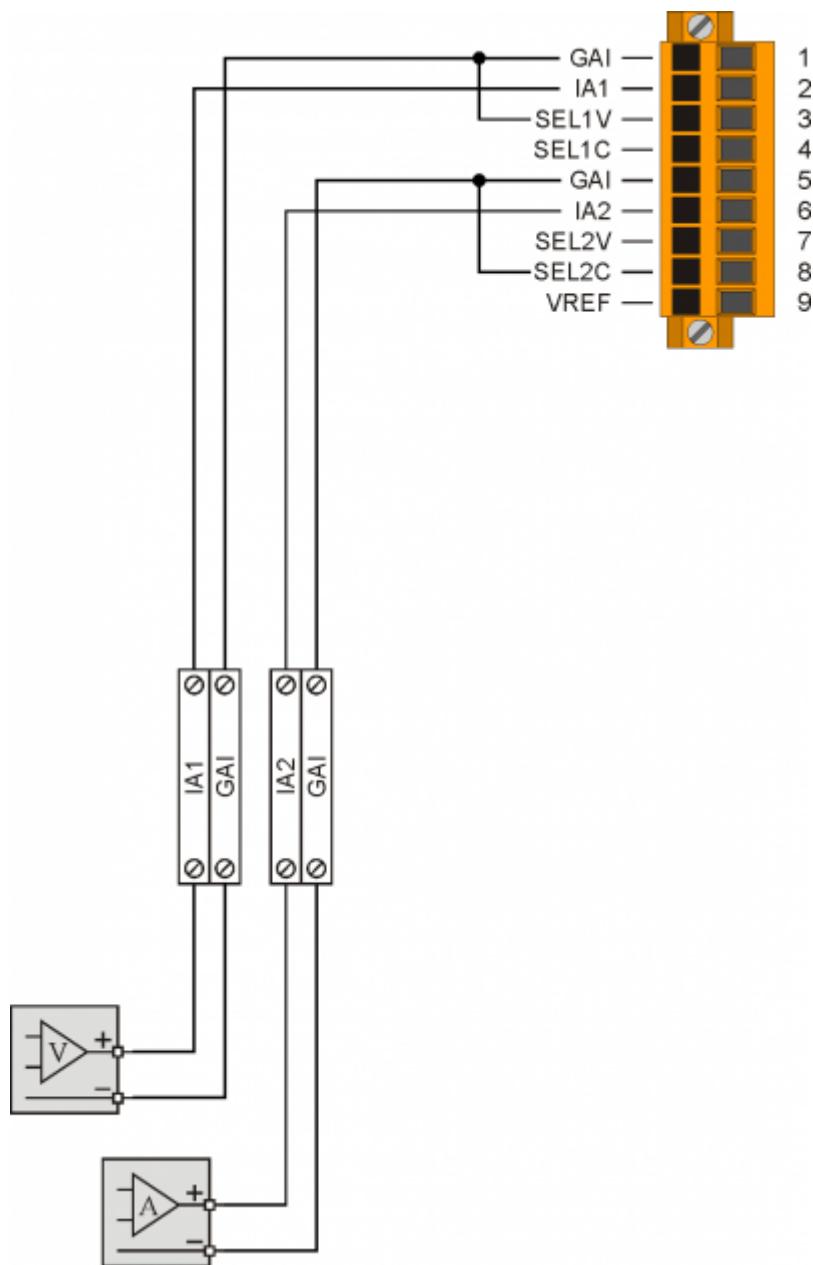


3.5 Voltmetric and potentiometric analog inputs

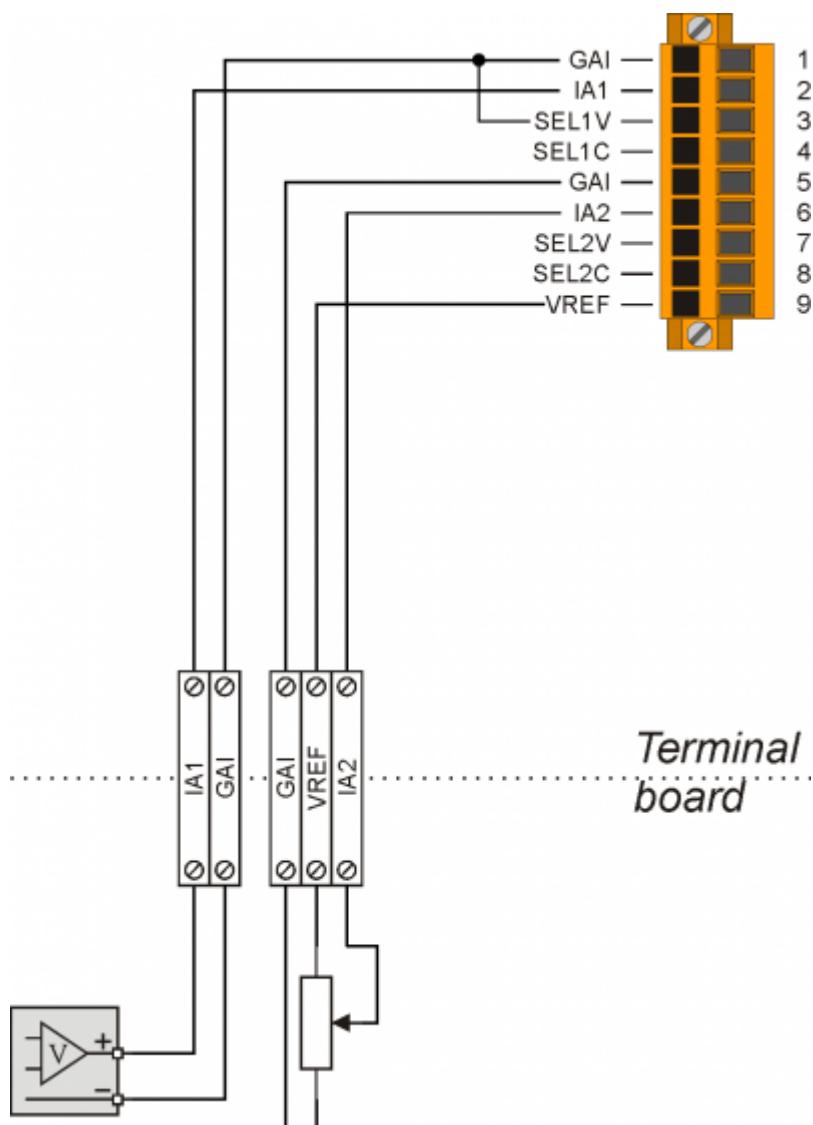


3.6 Protected digital outputs

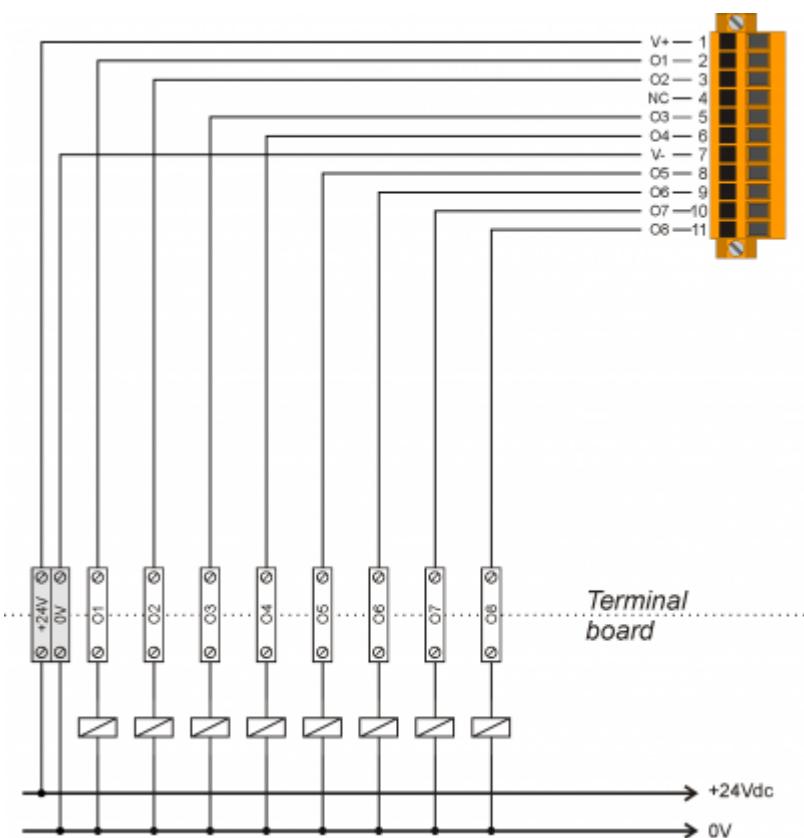


3.7 STEP - DIRECTION outputs 12V

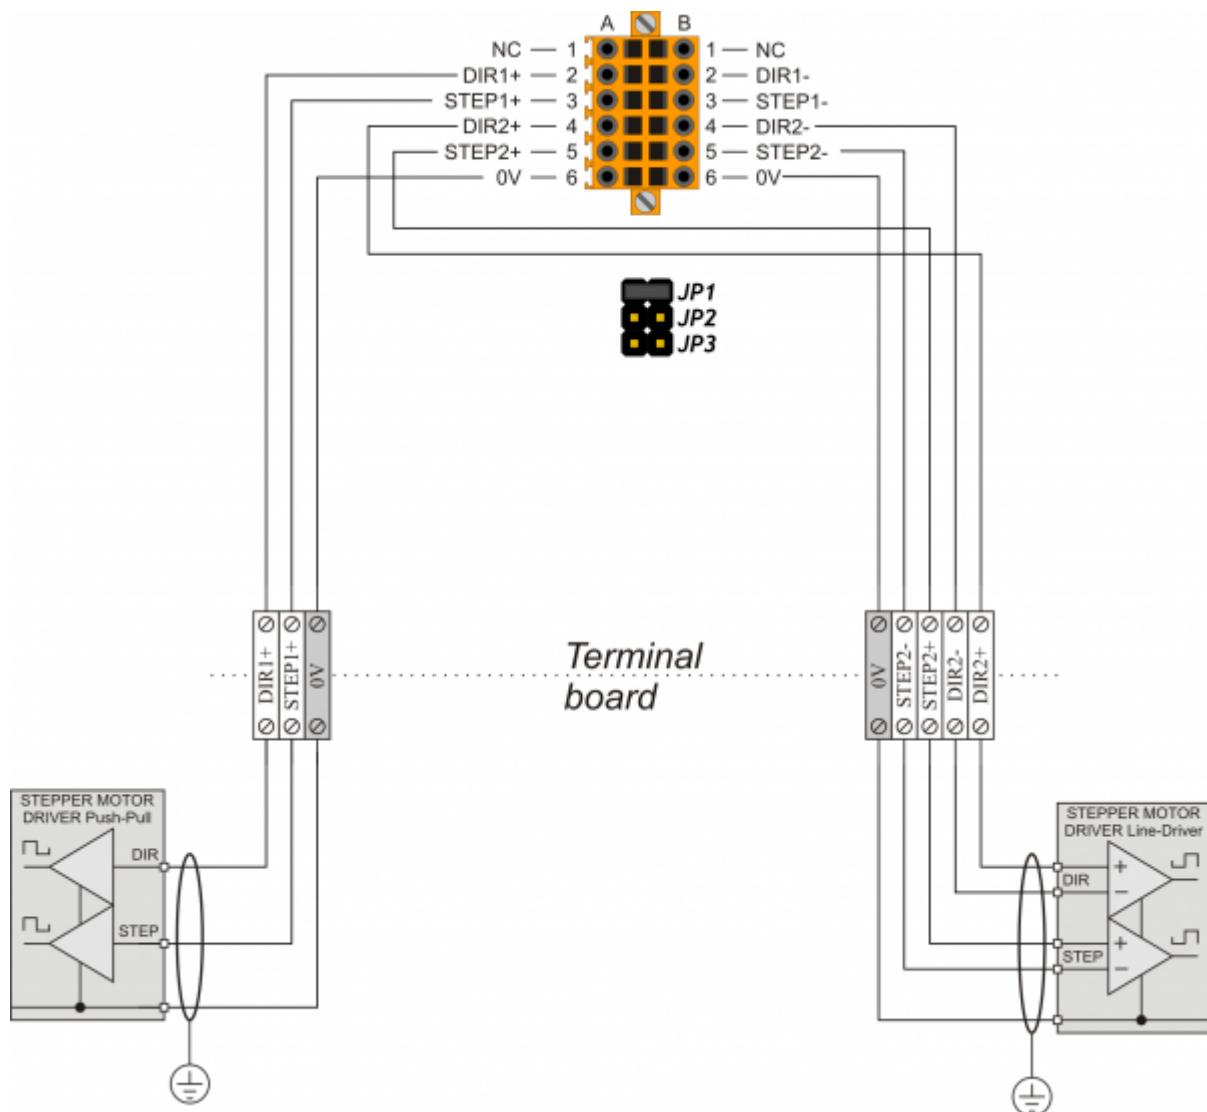

3.8 STEP - DIRECTION outputs 24V

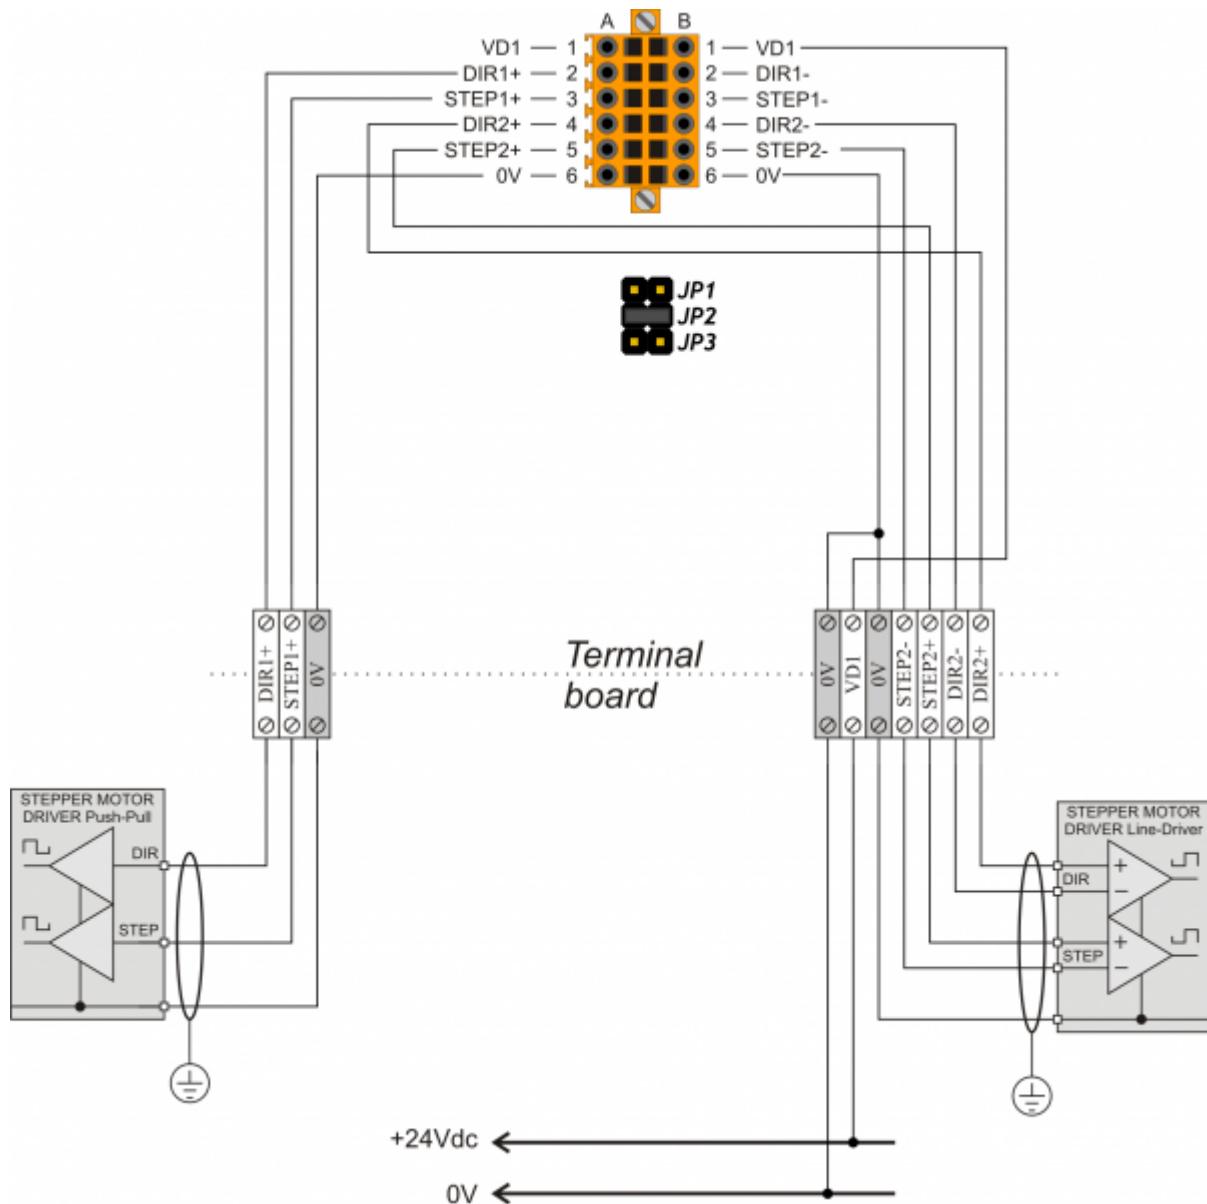

3.9 Analog outputs

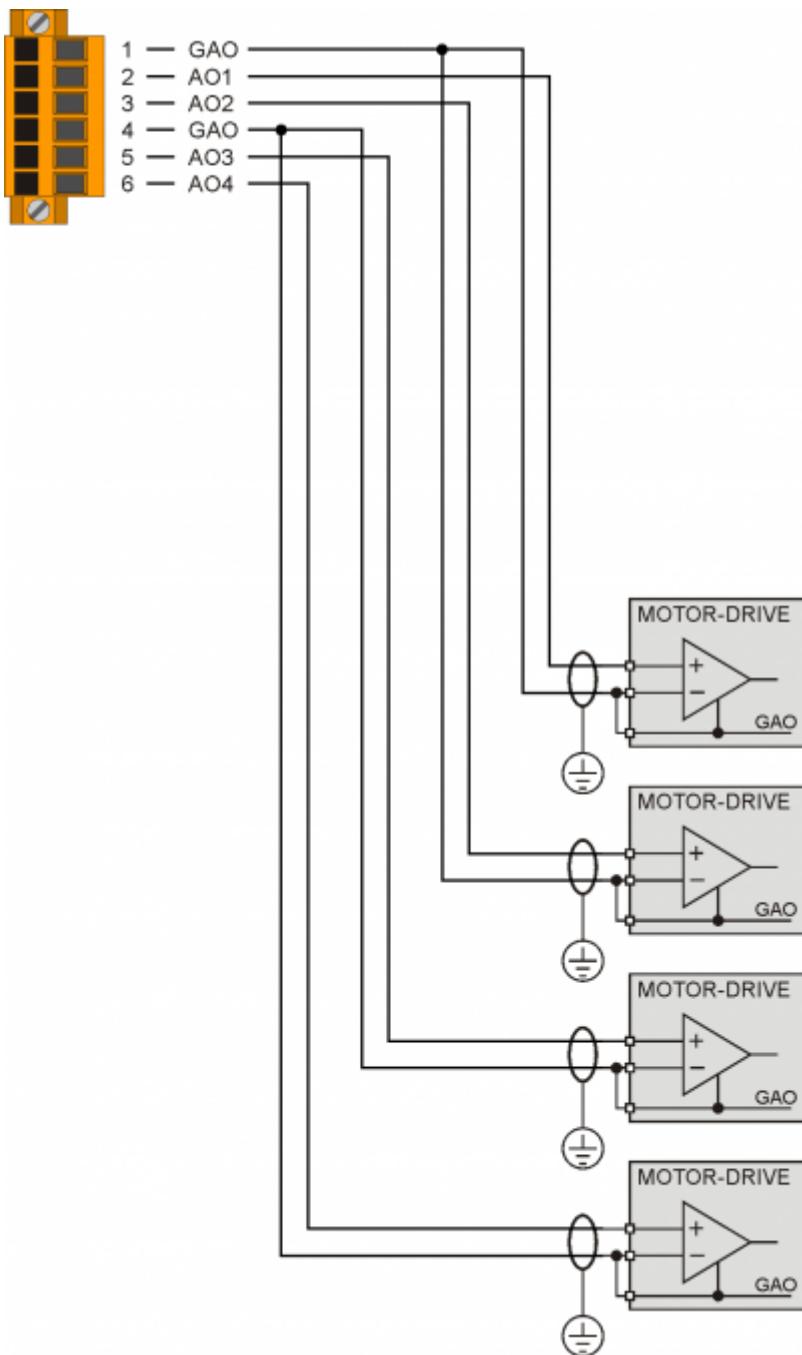

4. Electrical features


The following are the electrical hardware features.

The maximum and minimum frequency values and actual acquisition times, can still depend on any additional software filters, see the system variable "QMOVE:sys004".

4.0.1 Standard digital inputs


Type of polarisation	PNP
Min. acquisition time (hardware)	3ms
Isolation	1000Vrms
Rated operating voltage	24Vdc
Voltage of logic state 0	0-2 V
Voltage of logic state 1	10.5 - 26.5 V
Internal voltage drop	5V
Input resistance (R _i)	2700Ω
Sink current	2mA ÷ 8mA ¹⁾

¹⁾ CAUTION: If the device connected to the inputs needs a higher minimum current, inputs may not work properly.

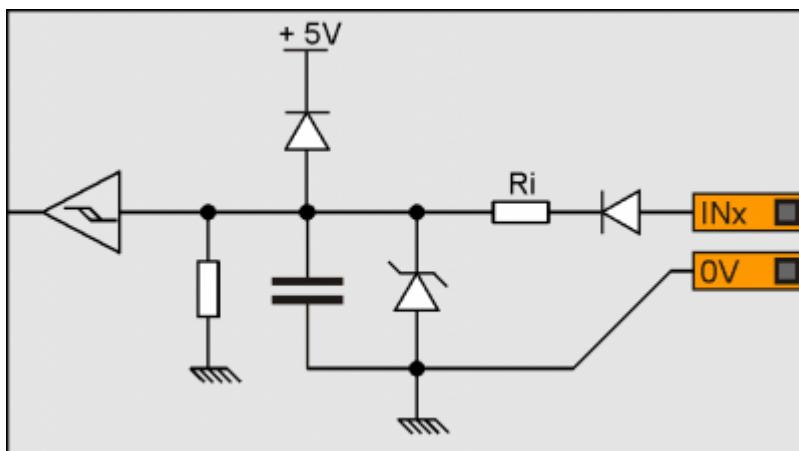

4.0.2 Rapid digital inputs

Type of polarisation	NPN / PNP
Max. frequency	200KHz
Min. acquisition time (hardware)	5µs
Insulation	1000Vrms
Rated operating voltage	24Vdc
Voltage of logic status 0	0-2 V
Voltage of logic status 1	10.5 - 26.5 V
Internal voltage drop	1.2 V
Input resistance	2700Ω

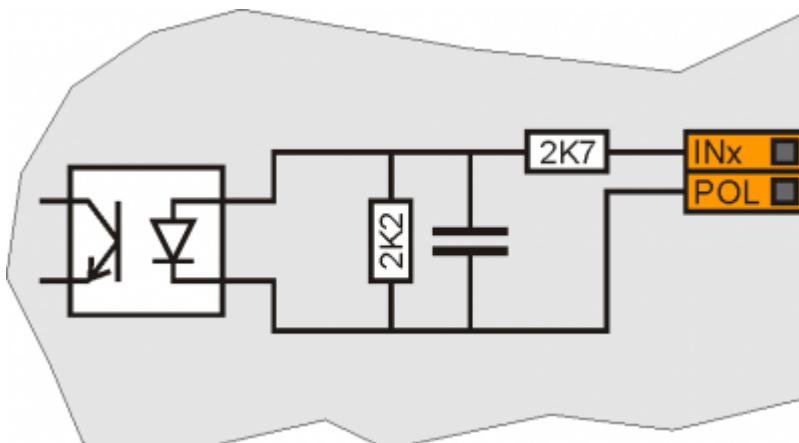

4.0.3 Bidirectional counter inputs 200KHz




The values given in the table refer to input signals A, B and Z.
The max. frequency given in the table refers to A and B phase signals with a DutyCycle = 50%
With count frequencies over 50KHz the use of Line-Driver type encoders is recommended.

Type of polarisation	PNP/PP
Max frequency	200KHz
Min. acquisition time	5µs
Insulation	1000Vrms
Rated operating voltage	24Vdc
Voltage of logic status 0	0 - 2 V
Voltage of logic status 1	10.5 - 26.5 V
Internal voltage drop	1.2V

Input resistance	3100Ω
------------------	-------


Line-Driver

Type of polarisation	Line-Driver
Max. frequency	200KHz
Min. acquisition time	5µs
Insulation	1000Vrms
Rated operating voltage (PHx+ ? PHx-)	5Vdc
Voltage of logic status 0 (PHx+ ? PHx-)	0-1.5 V
Voltage of logic status 1 (PHx+ ? PHx-)	2-5 V
Internal voltage drop	1.2V
Input restistance	150Ω

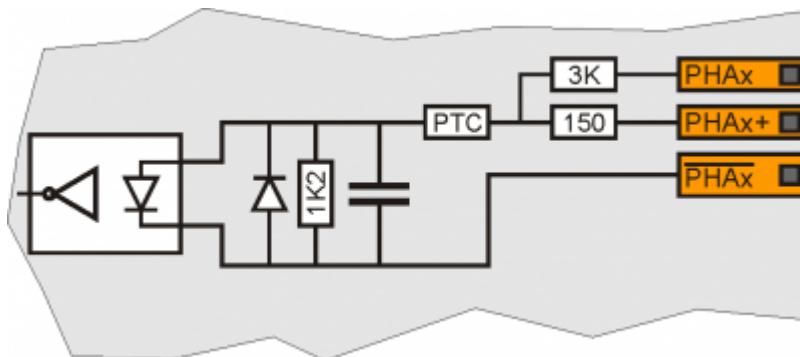


4.0.4 Potentiometric analog inputs

Type of connection	Potentiometric 1KΩ-20KΩ
Resolution	12bit/16bit
Reference voltage output	2.5Vdc
Max output current from reference	10mA
Input resistance	10MΩ
Max. linearity error	± 0,1% Vfs
Max. offset error	± 0,1% Vfs
S.n.	71 dB
Update speed	1ms
Insulation	1000 Vrms

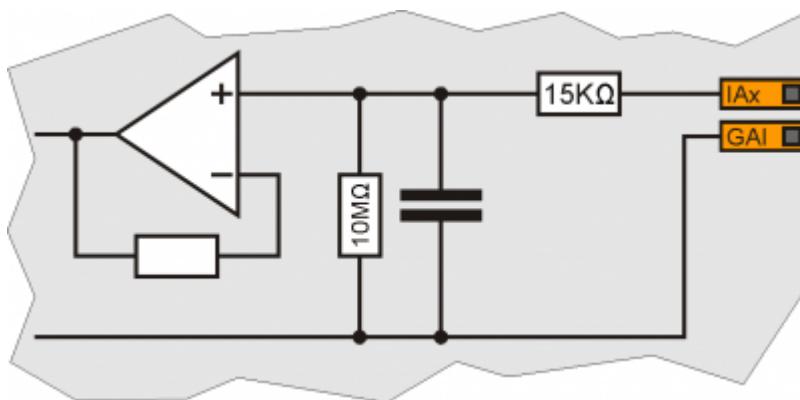


4.0.5 Voltmetric analog inputs

Type of connection	Voltmetric 0-10V
Resolution	12bit/16bit
Input resistance (Rin)	20kΩ
Damage value	20V
Max. linearity error	± 0.1% Vfs
Max. offset error	± 0.1% Vfs
S.n.	71 dB
Update speed	1ms
Insulation	1000 Vrms

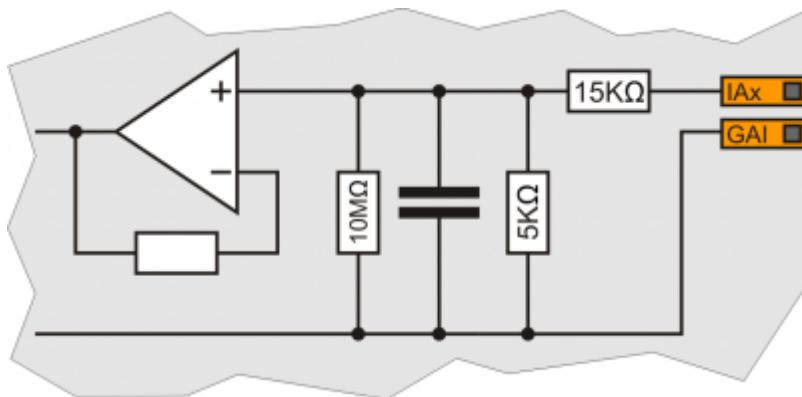


4.0.6 Amperometric analog inputs

Type of connection	Amperometric (0-20 mA)
Resolution	12bit/16bit
Input resistance	125Ω
Damage value	25 mA
Max. linearity error	± 0,1% Vfs
Max. offset error	± 0,1% Vfs
S.n.	71 dB
Update speed	1ms
Insulation	1000 Vrms

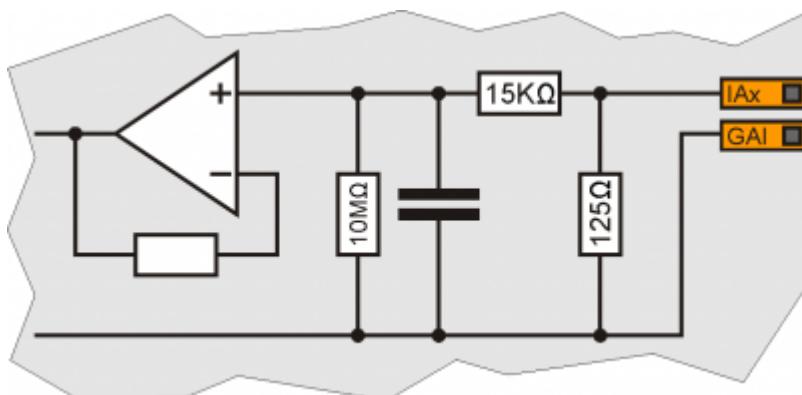


4.0.7 Protected digital outputs

Switchable load	Dc (PNP)
Max. operating voltage	28V
Insulation	1000Vpp
Max. internal voltage drop	600mV
Max internal resistance @ON	90mΩ
Max. protection current	12A
Max. operating current	2A
Max. current @OFF	5µA
Max switching time from ON to OFF	270µs
Max switching time from OFF to ON	250µs

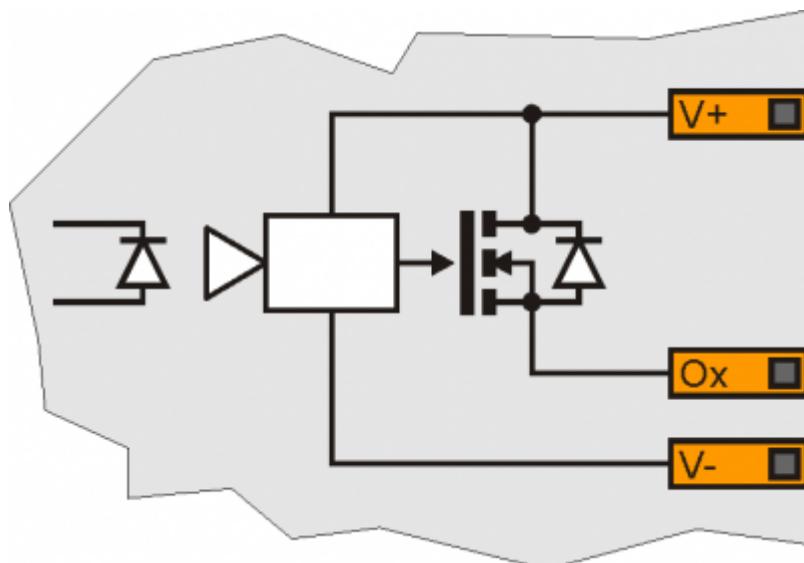


4.0.8 Stepper outputs

Type of polarisation	Push-Pull / Line-Driver
Max output frequency	50KHz
Insulation	1000Vpp
Max. operating current	20mA

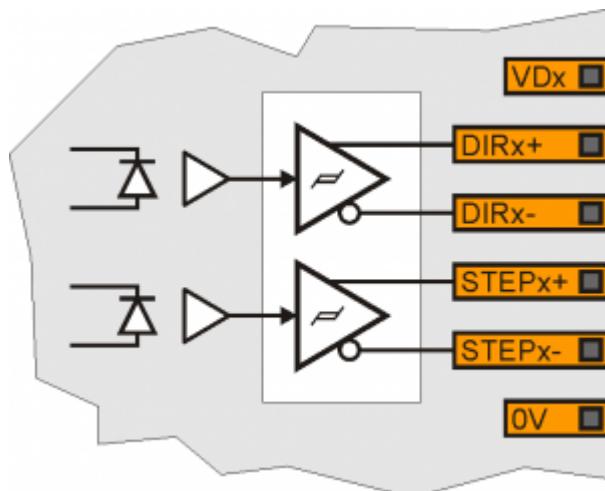

4.0.9 Analog outputs

Type of connection	Common mode
Insulation	1000Vrms
Voltage range (minimum no load)	-9.8V - +9.8V
Max. offset variation depending on temperature*	+/- 5mV
Resolution	16bit
Max. current	1mA
Output variation depending on load	100 μ V/mA
Output resistance	249 Ω

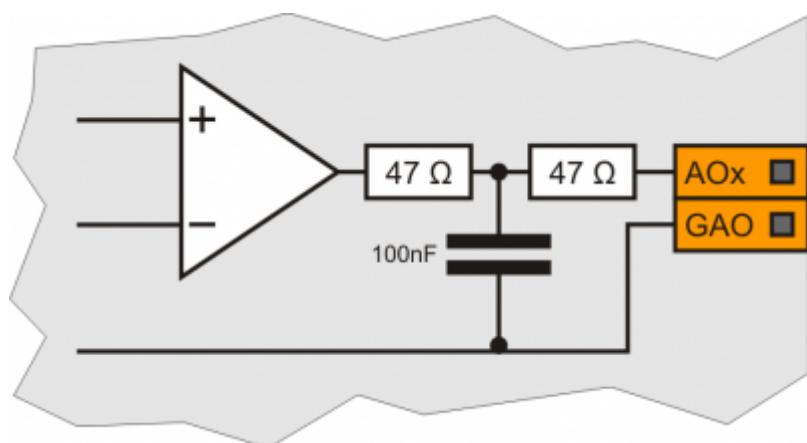

Documento generato automaticamente da **Qem Wiki** - <https://wiki.qem.it/>

Il contenuto wiki è costantemente aggiornato dal team di sviluppo, è quindi possibile che la versione online contenga informazioni più recenti di questo documento.